



WATER FLOW CHART SERIES 667/677

	Tested by SAPE	Date 2025-05-12	Ref. no. PP7786	Test tube 1"	Flow direct. Coupling to Nipple
Temp. 20 °C	Kv: 5,10	Coupling(Socket)	Nipple(Plug)		
Reg. no.	-		-		
CEJN Product	10 667 1400		10 667 6400		
Connection	NPT 3/4" female		NPT 3/4" female		
Remark	-		-		

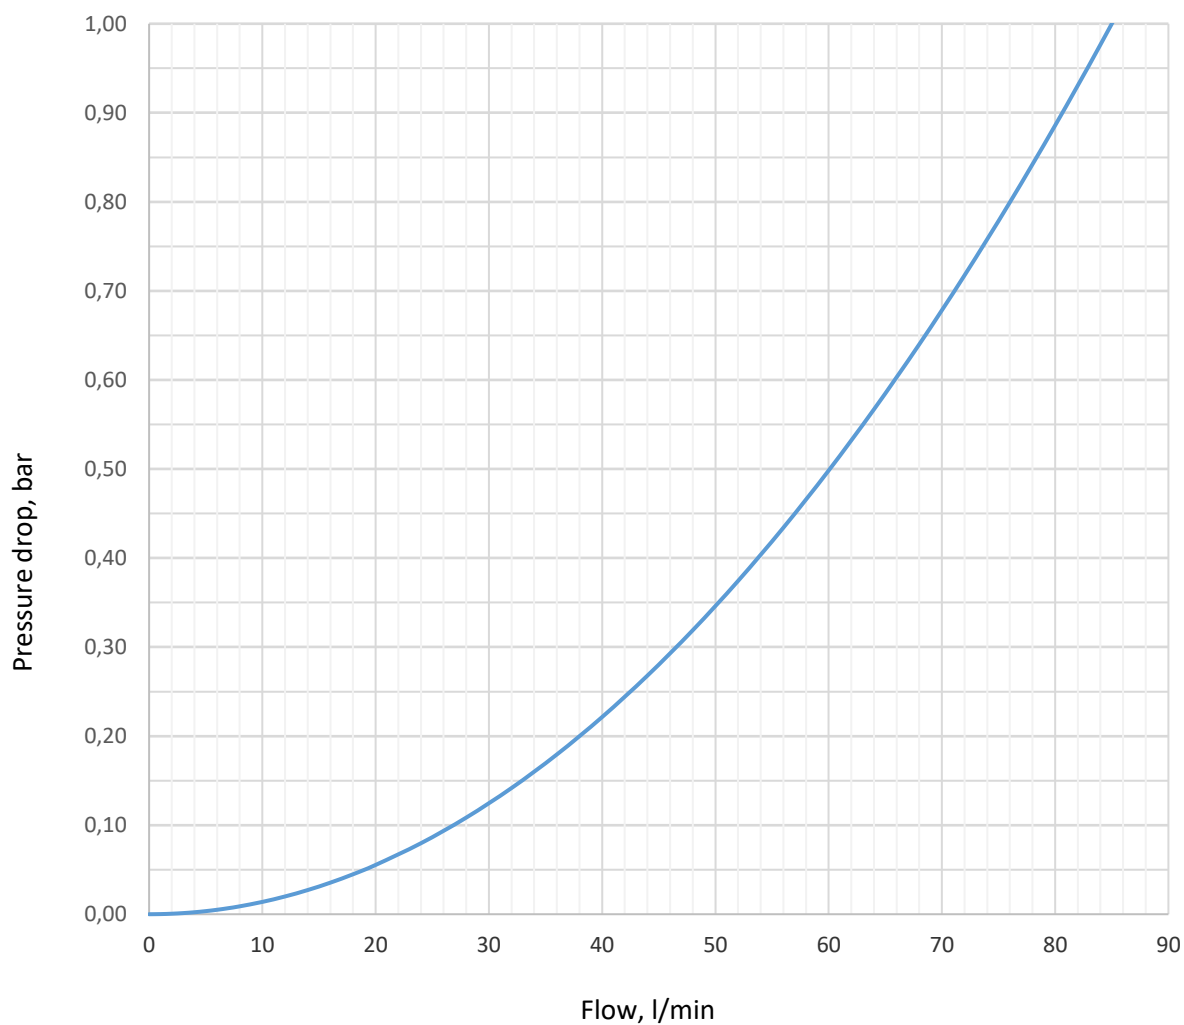


WATER FLOW CHART SERIES 667/677

	Tested by SAPE	Date 2025-05-12	Ref. no. PP7786	Test tube 1"	Flow direct. Nipple to Coupling
Temp. 20 °C	Kv: 5,02	Coupling(Socket)	Nipple(Plug)		
Reg. no.	-		-		
CEJN Product	10 667 1400		10 667 6400		
Connection	NPT 3/4" female		NPT 3/4" female		
Remark	-		-		

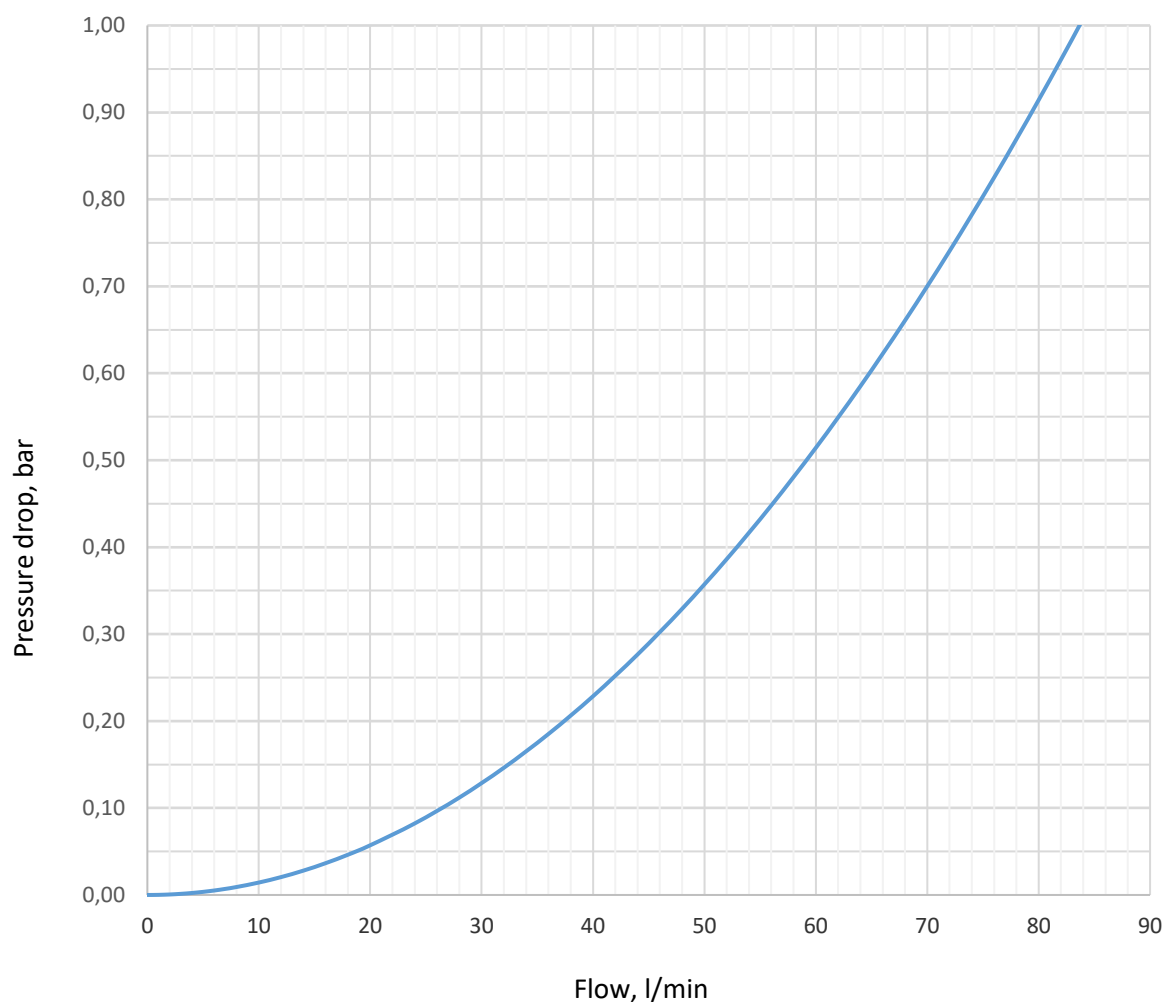

WATER FLOW CHART SERIES 667/677

	Tested by SAPE	Date 2025-05-12	Ref. no. PP7786	Test tube 1"	Flow direct. Coupling to Nipple
Temp. 72 °F	Cv: 5,93	Coupling(Socket)	Nipple(Plug)		
Reg. no.	-		-		
CEJN Product	10 667 1400		10 667 6400		
Connection	NPT 3/4" female		NPT 3/4" female		
Remark	-		-		

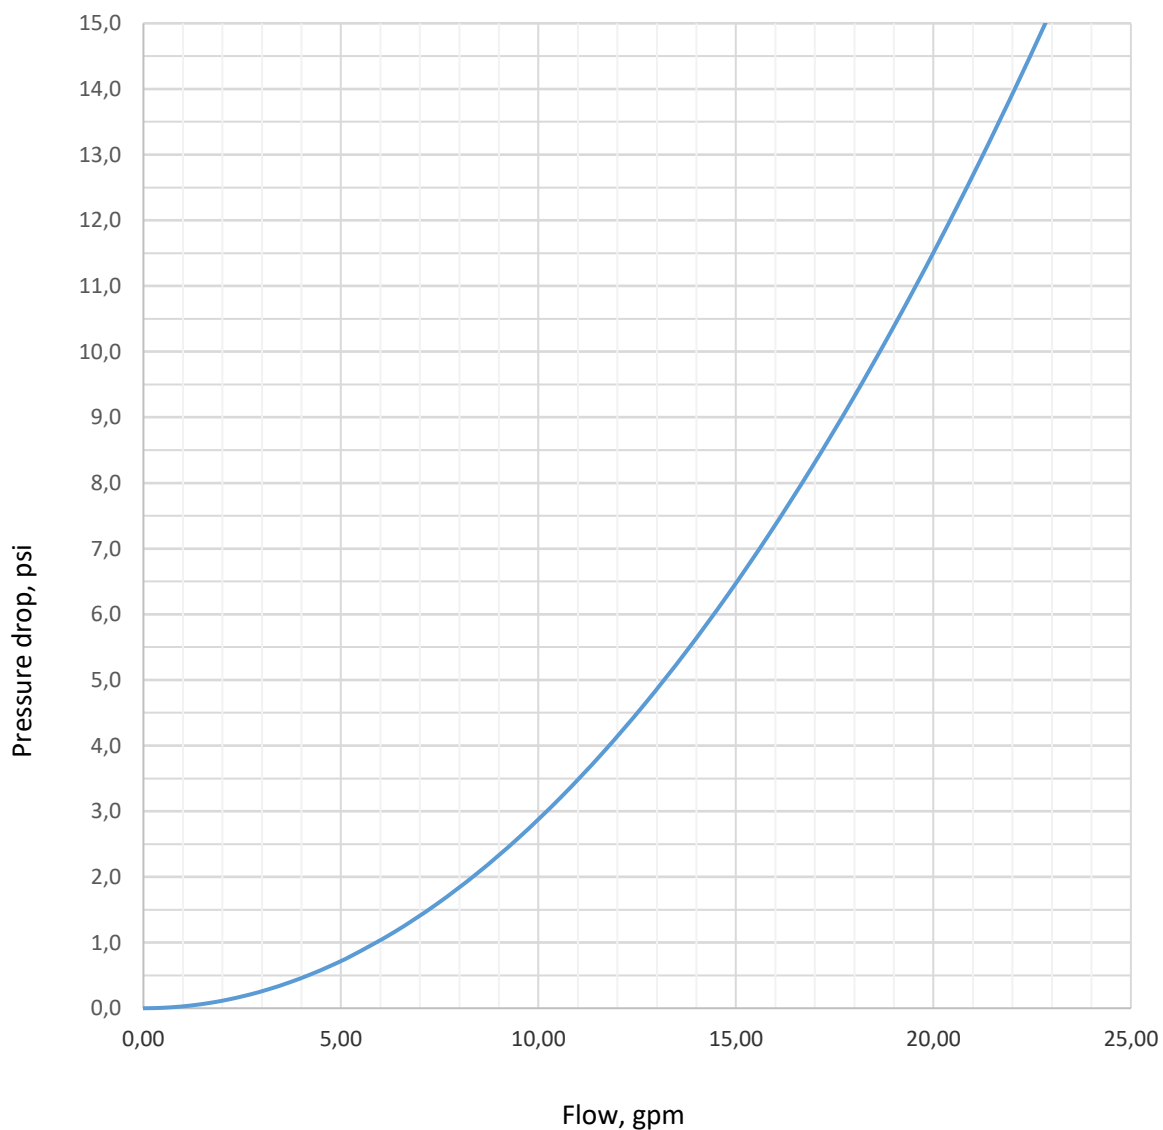

WATER FLOW CHART SERIES 667/677

	Tested by SAPE	Date 2025-05-12	Ref. no. PP7786	Test tube 1"	Flow direct. Nipple to Coupling
Temp. 72 °C	Cv: 5,83	Coupling(Socket)	Nipple(Plug)		
Reg. no.	-		-		
CEJN Product	10 667 1400		10 667 6400		
Connection	NPT 3/4" female		NPT 3/4" female		
Remark	-		-		

