



WATER FLOW CHART SERIES 767

	Tested by SAPE	Date 2025-05-07	Ref. no. PP7771	Test tube 1"	Flow direct. Coupling to Nipple
Temp. 20 °C	Kv: 13,32	Coupling(Socket)	Nipple(Plug)		
Reg. no.	-		-		
CEJN Product	10 767 1200		10 767 6200		
Connection	G1" female (BSP)		G1" female (BSP)		
Remark	-		-		

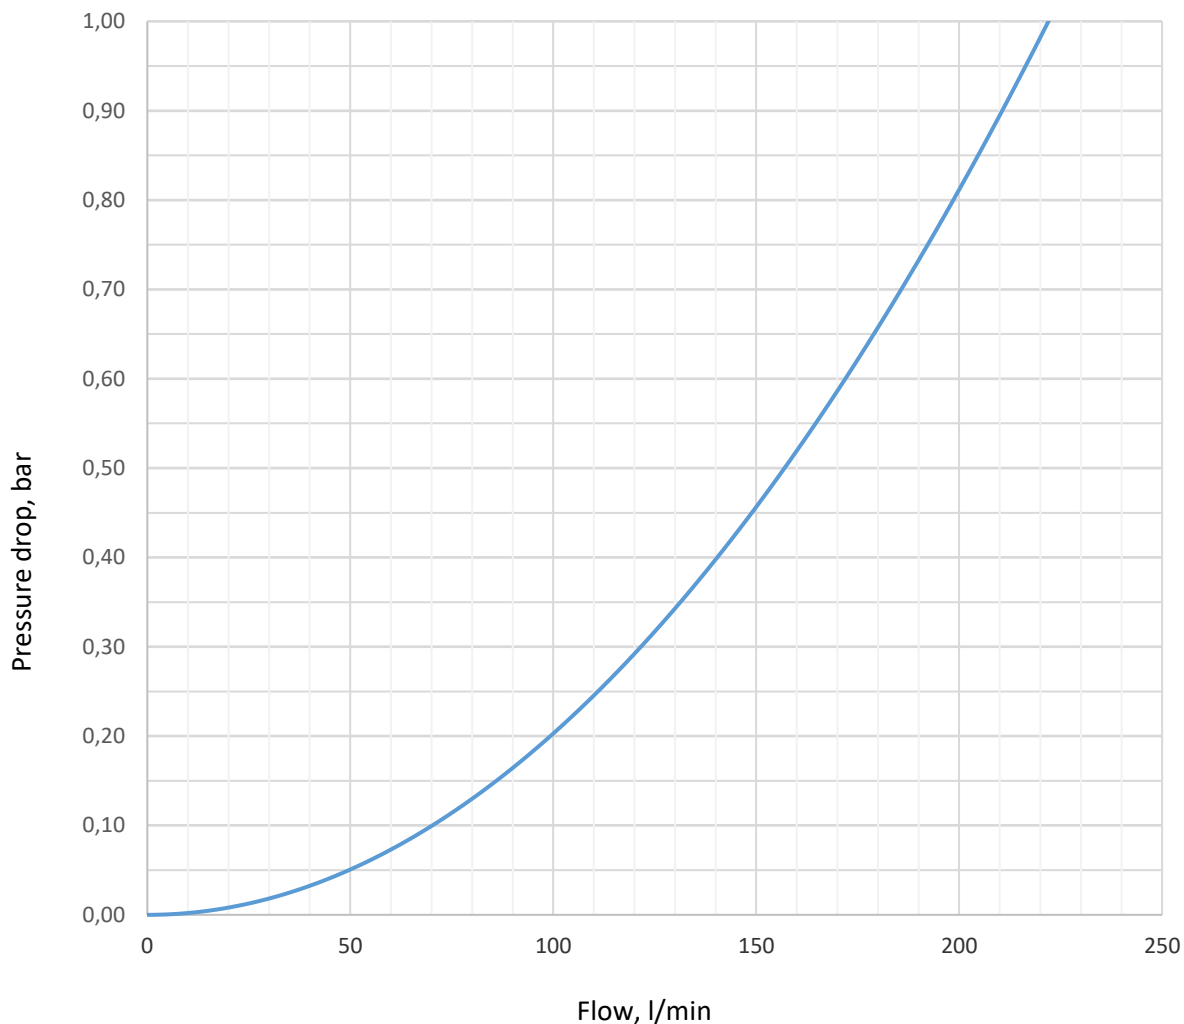


WATER FLOW CHART SERIES 767

	Tested by SAPE	Date 2025-05-07	Ref. no. PP777 1	Test tube 1"	Flow direct. Nipple to Coupling
Temp. 20 °C	Kv: 11,95	Coupling(Socket)	Nipple(Plug)		
Reg. no.	-		-		
CEJN Product	10 767 1200		10 767 6200		
Connection	G1" female (BSP)		G1" female (BSP)		
Remark	-		-		

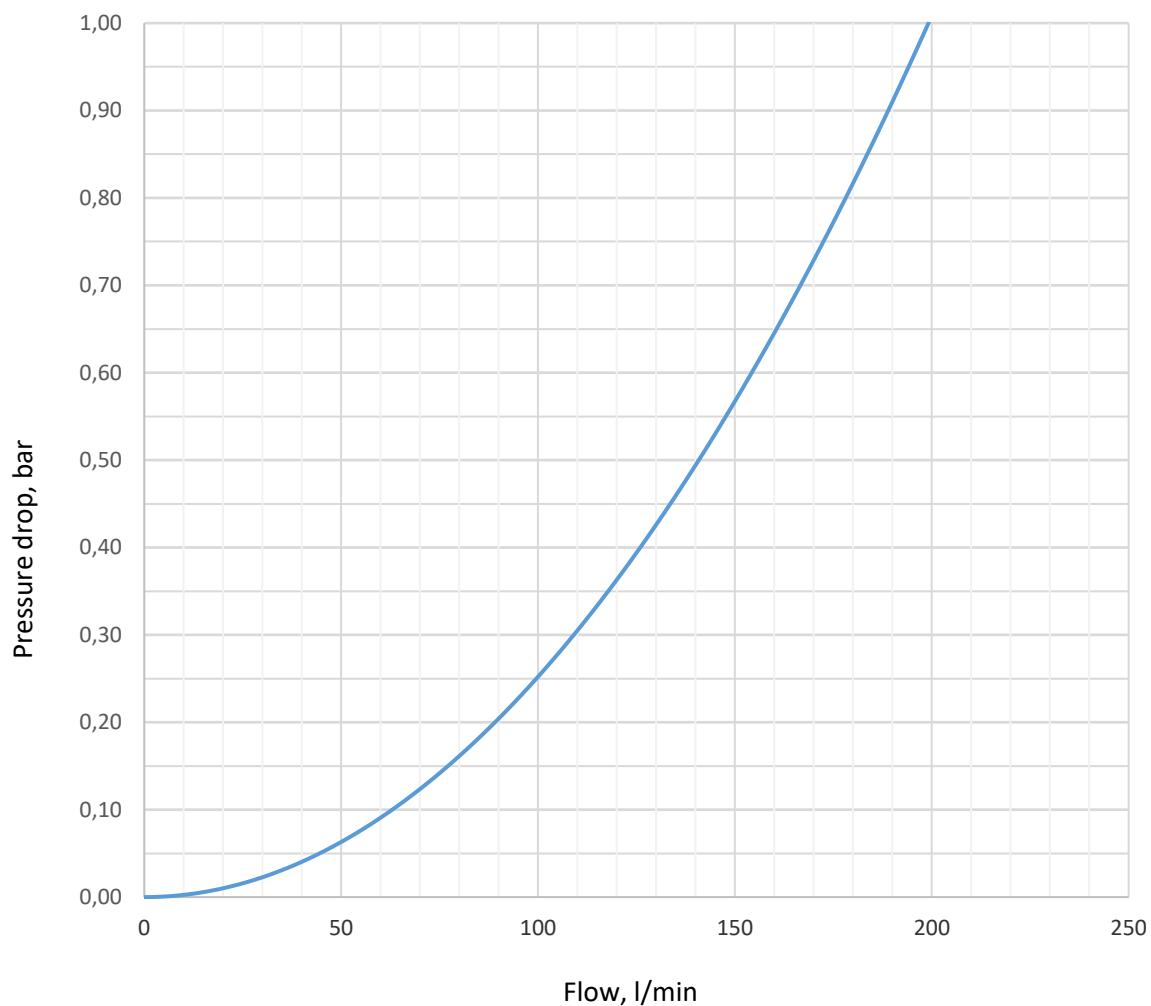

WATER FLOW CHART SERIES 767

	Tested by SAPE	Date 2025-05-07	Ref. no. PP7771	Test tube 1"	Flow direct. Coupling to Nipple
Temp. 72 °F	Cv: 15,49	Coupling(Socket)	Nipple(Plug)		
Reg. no.	-		-		
CEJN Product	10 767 1200		10 767 6200		
Connection	G1" female (BSP)		G1" female (BSP)		
Remark	-		-		

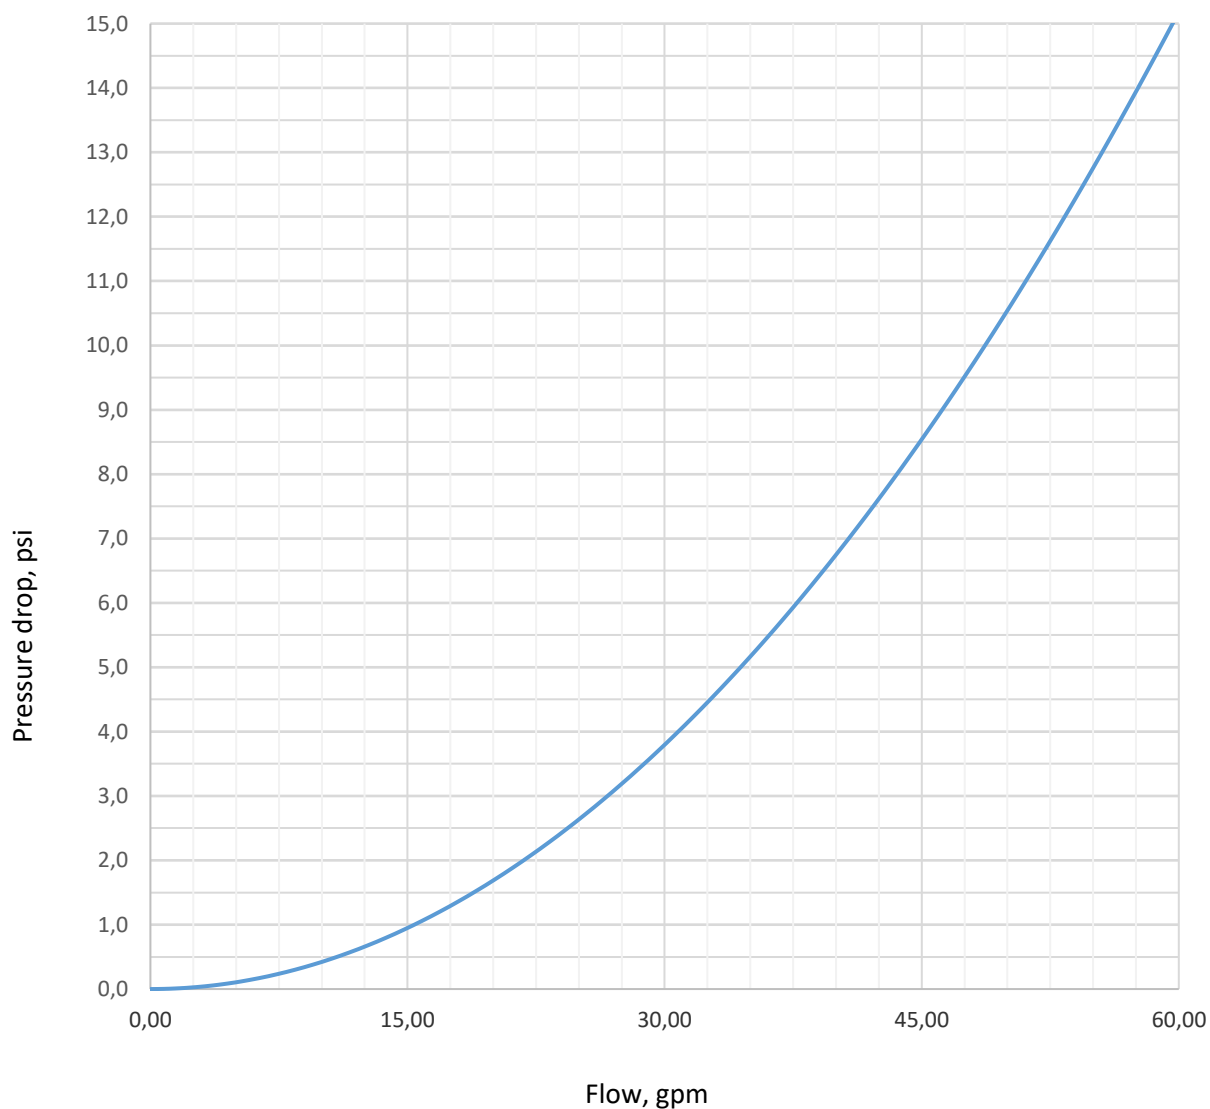

WATER FLOW CHART SERIES 767

	Tested by SAPE	Date 2025-05-07	Ref. no. PP7771	Test tube 1"	Flow direct. Nipple to Coupling
Temp. 72 °C	Cv: 13,89	Coupling(Socket)	Nipple(Plug)		
Reg. no.	-		-		
CEJN Product	10 767 1200		10 767 6200		
Connection	G1" female (BSP)		G1" female (BSP)		
Remark	-		-		

